



**PUBALI BANK LIMITED**  
**ICT OPERATION DIVISION**  
**HEAD OFFICE, 26 DILKUSHA C/A, DHAKA.**

PBL/HO/ICTOD/QUOTATION/5 KVA ONLINE UPS/ 1303(3) 2021

April 07, 2021

**Notice inviting quotation for supply of 05 (five) KVA Online UPS  
for different Branches, Sub-Branches, Offices, Banking Booths of our Bank.**


Sealed quotations are hereby invited from bonafide Manufactures or its Agents, Suppliers, Traders of UPS for supplying of 5 KVA Online UPS for different Branches, Sub -Branches, Offices, Banking Booths of our Bank as per following specification.

**Specification for 5KVA (10/10) Online UPS:**

SN	Feature	Product Description	Price	
1	General	Online UPS 5KVA ( <b>Low Frequency</b> ), 1Phase In & 1Phase Out and Ground	Tk.	
		Brand		Bidder Mention
		Model		Bidder Mention
		Country of Origin		Bidder Mention
		Country of Manufacture		Bidder Mention
		Capacity		5 KVA ( <b>Low Frequency</b> )
	Input	Backup		1 Hours (Full Load)
		Input voltage range		120-276Vac (Full Load)
		Nominal Voltage		220Vac (1Phase, 2 wire +G)
		Input Phase		1 Phase
	Output	Generator Input		Support
		Output Phase		1 Phase and Ground
		Output voltage range		220volt ±10%
		Frequency		50Hz
		Power Factor		0.9
		Overload Capacity		≤105%: continuous; 106%~110%:10 minute; 111%~125%:1 minute; 125%~150%:30 seconds
	Battery & Charger	Waveform		Pure Sine wave
		System Unit Voltage		192 Vdc or more
		Battery Brand		<b>LONG /DIAMEC /LEOCH /GIGOR /ROCKET</b>
		Battery Weight (Minimum)		<b>7.5A—2.2Kg /9A—2.5Kg/12A—3.8Kg/18A— 4.5Kg/26A—7Kg/40A—12.5Kg/60A— 18Kg/70A—19Kg/80A—21Kg/100A— 28Kg/120A—32Kg/150A—48Kg/200A —52Kg or more weight.</b>
		Quantity		16 Pcs /32Pcs or more
		Capacity		Bidder Mention
		Battery Type		Sealed Maintenance Free ( <b>SMF</b> )
	Other Features	Charge Current		Built-in : 4A or Higher
		Maintenance Bypass Switch		Built-in
		Monitoring System		LED Display
	Accessories	Generator Support		Yes
		Manual Bypass DB		Yes (Must be)
		Electrical wire (BRB /Estern /BBS /SQ /Partex /Paradise /Singer etc)		To complete install online UPS.
		Circuit Breaker (ABB /Legrand /Schneider etc)		To complete install online UPS.
Site Visit	Raw material	DB Box, Connector, Lux, Cable tie, Royal Plug, Screw, Electrical Tape etc.		
	Pre inspection	Site visit preferred, if supplier are interested.		
Warranty	System Unit & Battery	2 Year Full warranty (System Unit & Battery)		
<b>Unit Price</b> (Including VAT & IT)	Price are included with Installation Charge, Electrical wire, Circuit Breaker, Raw materials and others if needed.		Tk.	

**Terms and conditions:**

- 1) The offer must be submitted through "**Offering Sheet**" enclosed with the schedule.
- 2) Bidder must be an authorized **distributor/reseller** of the product.
- 3) **The UPS to be supplied to Hardware Section of ICT Operation Division, Head Office, Dhaka for**

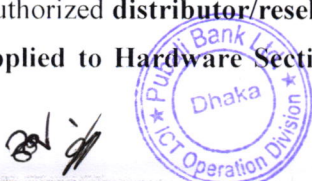

testing and verification. After testing the UPS by ICT Operation Division, Head Office successful bidder will supply the UPS to the concerned branch.

- 4) **10% (ten percent) of the bill** amount will be retained as Security Money which will be paid to the supplier after expiry of the warranty period at the satisfaction of the purchaser.
- 5) All Tax, Vat, Govt. Duties etc. will be deducted from the bill as per rule prior to payment of the same.
- 6) Payment of the bills will be made from ICT Operation Division, Head Office, Dhaka after delivery of the same at the PBTI as per terms of the Supply Order on production of a certificate from the concerned PBTI to the effect that the UPS is supplied in good condition as per Supply Order and is working properly.
- 7) In case of any trouble with the UPS within the warranty period the supplier shall have to replace/repair the UPS free of cost at the premises the PBTI where it will be supplied within 24(twenty four) hours. If the UPS is not in repairable condition on the premises, it should be replaced by a similar one within 24 (twenty four) hours from getting the information of trouble prior to bring the same at their end for repairing purpose. In case of failure of the supplier, the Bank shall have the right to get the replacement or repairing works done by other agency at the cost of the supplier. Such costs will be adjusted from the supplier's security money and the supplier shall have no objection to it.
- 8) **Successful bidder** must ensure delivery of UPS **within 15(fifteen) days** of getting work order.
- 9) The authority reserves the right to accept or reject all or any offer without assigning any reason.
- 10) **Bank is not bound** to accept the lowest Quotation. To be successful in the bid, quality of the offered items, financial capability, reputation etc. of the firm as assessed by the Bank are the prime factors for consideration.
- 11) The successful bidder shall have to inform the Bank **1(one) month before** if they want to discontinue supply of the UPS.
- 12) Photocopy of Trade License, BSTI Certificate, TIN Certificate, VAT registration Certificate (if any), Financial Solvency Certificate (if any), Appreciation letter, Major client List and Company profile to be submitted with the Quotation.

Offer / Bid to be dropped in the **Tender Box kept in Establishment Division, Pubali Bank Limited, Head Office, 12<sup>th</sup> Floor, 26 Dilkusha C/A, Dhaka by 11-00 a.m. up to 21-04-2021** which will be opened on the same day at 11.30 a.m. in presence of the bidders present (if any).

Sd/-

(Md. Aminul Islam)  
Asst. General Manager

CC TO : The Member Secretary, Purchase Committee, Pubali Bank Ltd., Head Office,  
Dhaka for information and necessary action.


CC TO : Notice Board, Pubali Bank Ltd., Head Office, Dhaka.

CC TO : [www.pubalibangla.com](http://www.pubalibangla.com)

  
Asst. General Manager

Sd/-

(Md. Helal Uddin)  
GM & Division Head

  
GM & Division Head

## OFFERING SHEET

(To be submitted along with the offer)

Tenderer's Name :

Address :

### Tender Notice for Supply of 05 KVA Online UPS.

SN	Feature	Product Description	Price
1	General	Online UPS 5KVA ( <b>Low Frequency</b> ), 1Phase In & 1Phase Out and Ground	Tk.
		Brand Bidder Mention	
		Model Bidder Mention	
		Country of Origin Bidder Mention	
		Country of Manufacture Bidder Mention	
		Capacity 5 KVA ( <b>Low Frequency</b> )	
		Backup 1 Hours (Full Load)	
Input	Input voltage range	120-276Vac (Full Load)	
	Nominal Voltage	220Vac (1Phase, 2 wire +G)	
	Input Phase	1 Phase	
	Generator Input	Support	
Output	Output Phase	1 Phase and Ground	
	Output voltage range	220volt ±10%	
	Frequency	50Hz	
	Power Factor	0.9	
	Overload Capacity	≤105%: continuous; 106%~110%:10 minute; 111%~125%:1 minute; 125%~150%:30 seconds	
	Waveform	Pure Sine wave	
Battery & Charger	System Unit Voltage	192 Vdc or more	
	Battery Brand	<b>LONG /DIAMEC /LEOCH /GIGOR /ROCKET</b>	
	Battery Weight (Minimum)	<b>7.5A—2.2Kg /9A—2.5Kg/12A—3.8Kg/18A—4.5Kg/26A—7Kg/40A—12.5Kg/60A—18Kg/70A—19Kg/80A—21Kg/100A—28Kg/120A—32Kg/150A—48Kg/200A—52Kg</b> or more weight.	
	Quantity	16 Pcs /32Pcs or more	
	Capacity	Bidder Mention	
	Battery Type	Sealed Maintenance Free ( <b>SMF</b> )	
	Charge Current	Built-in : 4A or Higher	
Other Features	Maintenance Bypass Switch	Built-in	
	Monitoring System	LED Display	
	Generator Support	Yes	
Accessories	Manual Bypass DB	Yes (Must be)	
	Electrical wire (BRB /Estern /BBS /SQ /Partex /Paradise /Singer etc)	To complete install online UPS.	
	Circuit Breaker (ABB /Legrand /Schneider etc)	To complete install online UPS.	
	Raw material	DB Box, Connector, Lux, Cable tie, Royal Plug, Screw, Electrical Tape etc.	
Site Visit	Pre inspection	Site visit preferred, if supplier are interested.	
Warranty	System Unit & Battery	2 Year Full warranty (System Unit & Battery)	
<b>Unit Price</b> (Including VAT & IT)	Price are included with Installation Charge, Electrical wire, Circuit Breaker, Raw materials and others if needed.		Tk.

**Authorized Signature**